

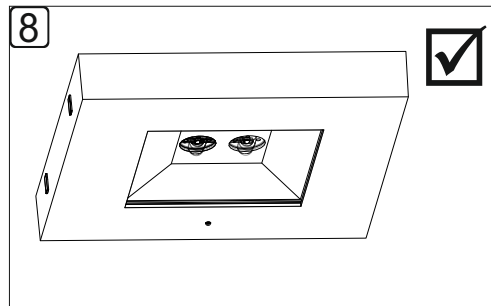
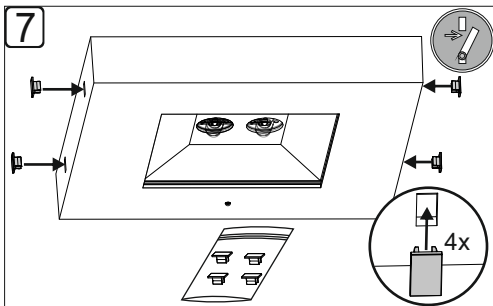
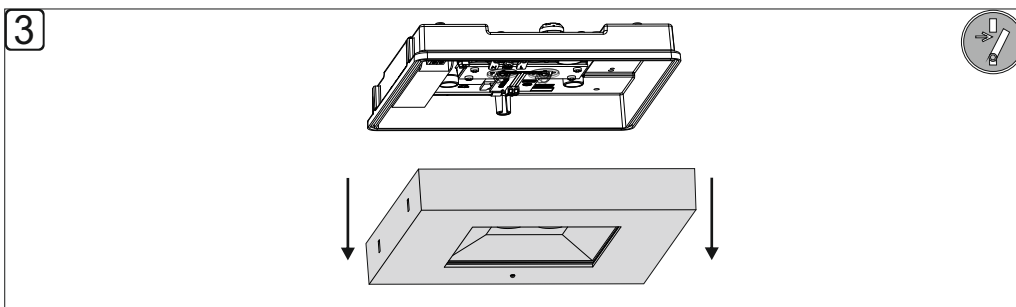


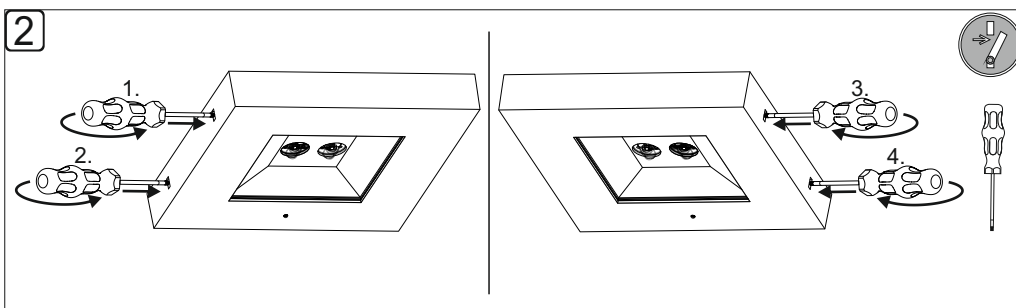

Demontage von Abdeckung: / demounting of covering

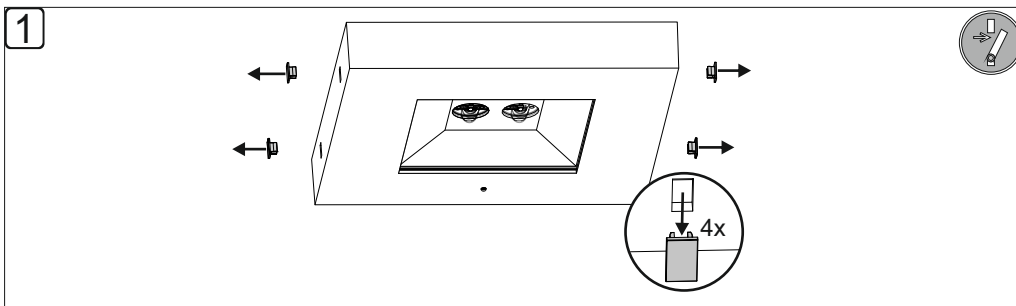


INSTRUCTION

Centryxx Deckenanbau /
ceiling luminaire
Zentralbatterie/ central battery

09-3104.062
36-2017

RZB
LIGHTING


IP 65 F CE LED 220 - 240 V / 0/50-60 Hz 3 x 1,5 mm²(2,5 mm²) 5 x 1,5 mm²(2,5 mm²) nur bei .89 only for .89

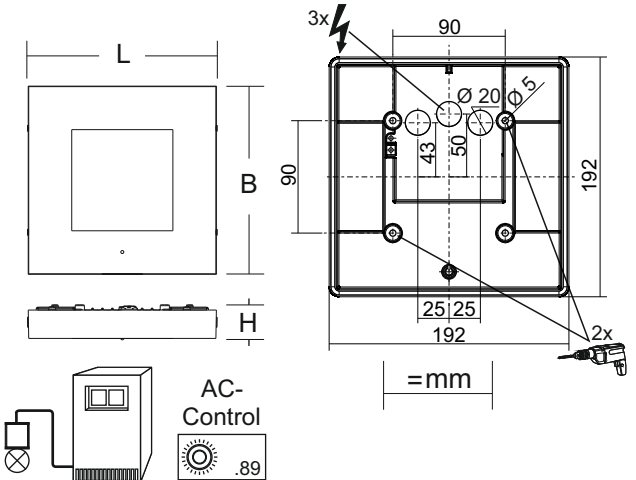

Zentralbatterie/ central battery					
				P	
672171.002	L 198, B 198, H 38	2 x LED	7 W	0,73 Kg	
672171.002.1	L 198, B 198, H 38	2 x LED	7 W	0,73 Kg	
672170.002.89	L 198, B 198, H 38	2 x LED	7 W	0,80 Kg	
672170.002.1.89	L 198, B 198, H 38	2 x LED	7 W	0,80 Kg	
672170.002.2	L 198, B 198, H 38	2 x LED	7 W	0,73 Kg	
672170.002.2.89	L 198, B 198, H 38	2 x LED	7 W	0,80 Kg	
672294.002	L 198, B 198, H 38	2 x LED	3,5 W	0,73 Kg	
672294.002.1	L 198, B 198, H 38	2 x LED	3,5 W	0,73 Kg	
672294.002.89	L 198, B 198, H 38	2 x LED	3,5 W	0,80 Kg	
672294.002.1.89	L 198, B 198, H 38	2 x LED	3,5 W	0,80 Kg	



Die Leuchte darf nur mit ihren vollständigen Schutzabdeckungen betrieben werden.
The luminaire must be used with its complete protective covers only.



EN 12464



EN 12464



RZB
Rudolf Zimmermann,
Bamberg GmbH
Rheinstraße 16
D-96052 Bamberg
Deutschland
Telefon +49 951/79 09-0
Telefax +49 951/79 09-198
www.rzb.de
info@rzb-leuchten.de

		
	08-1403.022 L 198, B 198, H 30	248 g
	08-6102.002 L 10,5, B 6, H 5	0,1 g
	09-4084.003 L 189, B 189, d 3	3 g

		
	982257.002 L 201, B 102,5, H 199,6	600 g
	982274.002 L 110, B 104, H 13,5	100 g
	982341.002 L 130, B 130, H 10	150 g

Unsere Sicherheitsleuchten sind entsprechend den aktuell gültigen Leuchtenbauvorschriften gekennzeichnet.
Die Form der Kennzeichnung ist wie folgt, als Beispiel dargestellt.

Z 1 A

Feld 1: Bauart, Feld 2: Betriebsart, Feld 3: Einrichtungen wie Selbsttest u.s.w.

Die von uns gelieferten Leuchten sind als Leuchten in Dauerschaltung gekennzeichnet. Wollen Sie die Leuchten in Bereitschaftschaltung betreiben, muß der Eintrag in Feld 2 geändert werden. Bitte kennzeichnen Sie dann 1-lampige Leuchten mit 0 anstatt der 1 und mehrlampige Leuchten mit 2 anstatt der 3.

Our safety luminaires are marked according to the currently valid construction standards.
The type of marking can be seen in the following example.

Z 1 A

Field 1: Type of construction, Field 2: Type of operation, Field 3: Additional features such as self test etc.

The default type of operation of our luminaires is maintained. If you change the type of operation to non-maintained you will have to change the entry in field 2 Please change the "1" to "0" for luminaires equipped with 1 lamp and "3" to "2" for luminaires equipped with more than one lamp.

